



GENERAL NOTES

1. IF SURFACE IS NOT TO OFFICAL GRADE AT TIME OF INSTALLATION OF METER, OWNER MUST RAISE OR LOWER PIT WHEN SURFACE IS AT FINAL GRADE.
2. METER SETTING MUST BE INSPECTED BEFOR BACKFILLING.
3. BYPASS IS TO BE INSTALLED UNLESS OTHERWISE SPECIFIED.
4. NO CONCRETE TO BE LAID IN FLOOR OF METER PIT.
5. PIPING SHALL BE TYPE "K" COPPER OR THREADED BRASS.
6. IF GROUND CONDITIONS ARE UNSTABLE, THE ENGINEER MAY REQUIRE THAT FOOTINGS BE INSTALLED. IF FOOTINGS ARE REQUIRED, THEY SHALL BE AS SHOWN ON SHEET W13 OF 25.
7. THE WORD "WATER" SHALL BE CAST ON THE LID.
8. 3/4" OR 1-1/2" ROCK SHALL BE PLACED IN THE FLOOR OF METER PIT 6" THICK.
9. SUPPORT UNDER METER MAY BE BRICK OR CONCRETE BLOCK.
10. COMPRESSION JOINTS MAY BE USED INSIDE VAULT.
11. CHECK VALVE TO THE DISCRETION OF BACKFLOW PREVENTION ENGINEER.

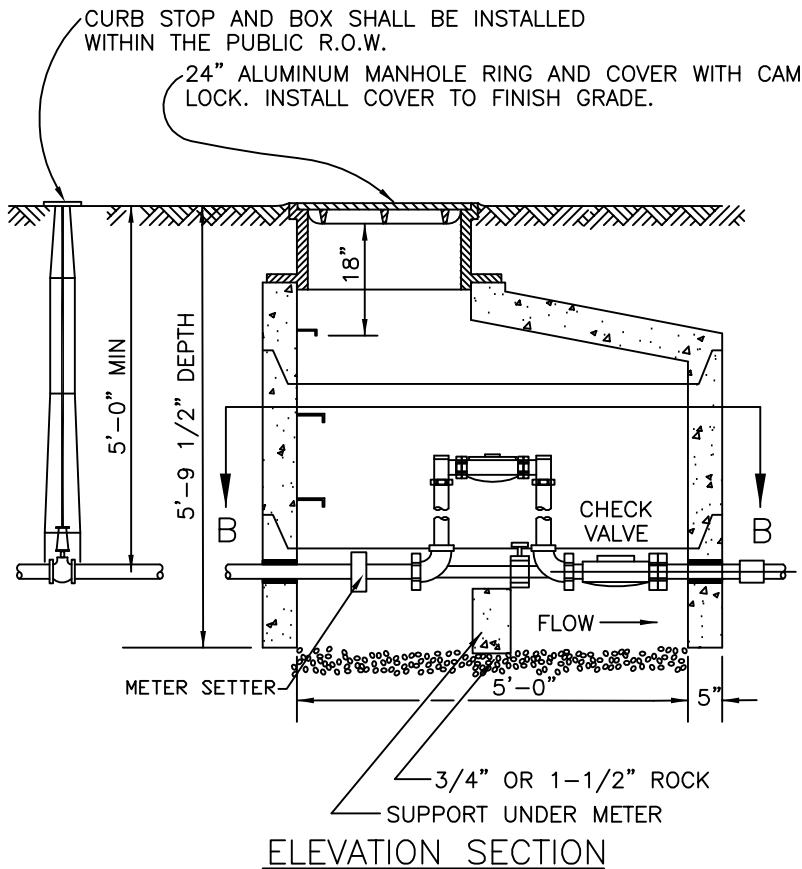

SIZE	FORD CUSTOM SETTER		MUELLER	
	SIZE	CAT NO	SIZE	CAT NO
1-1/2"	FLANGED KEY VALVE	V V76-128-11-55 1" BY-PASS	FLANGED ANGLE METER	H-1423
1-1/2"	FLANGED ANGLE BALL VALVE	V 8876-128-11-55 1" BY-PASS	FLANGED BALL ANGLE	H-2423
2"	FLANGED KEY VALVE	V V77-128-11-77 1,1/2" BY-PASS	FLANGED ANGLE METER STOP	H-1423
2"	FLANGED ANGLE BALL VALVE	V 8876-128-11-55 1, 1/2" BY-PASS	FLANGED ANGLE BALL VALVE	H-2423

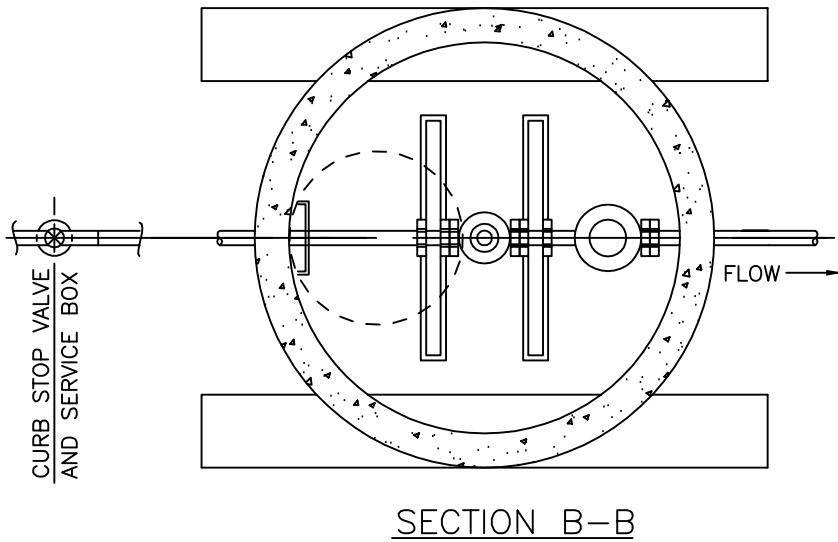

CITY of DELTA
360 MAIN STREET
DELTA, CO 81416

METER SETTING FOR 1-1/2" & 2"
METER WITH VALVE & BYPASS

DATE: DEC. 1998

SHEET W10 OF 24